


NOTE:
WHERE SEWER STUBS OR HOUSE
CONNECTIONS ARE CALLED FOR,
STANDARD CHANNEL SHALL BE
CONSTRUCTED IN BOTTOM OF
MANHOLE, IN SAME MANNER AS FOR
INTERSECTING SEWER.

SECTION A-A

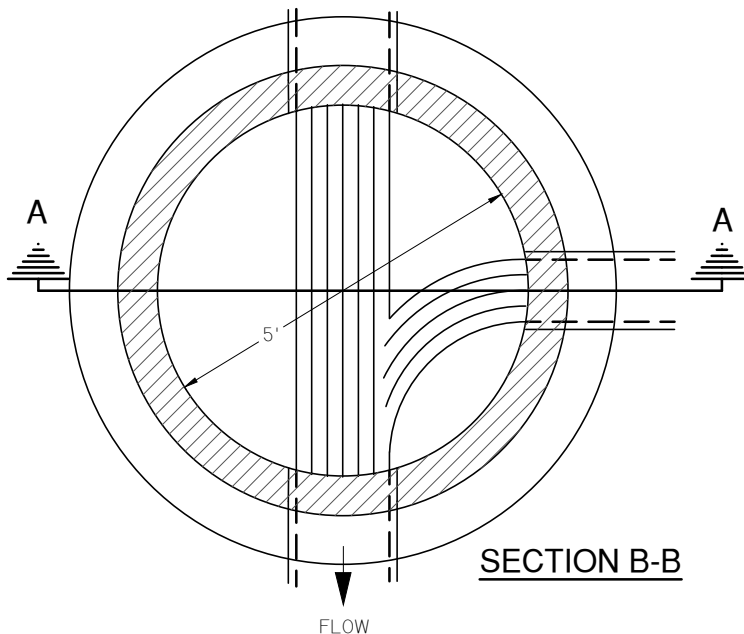

SECTION B-B

NOTE:
STRUCTURE SHALL BE PRE-CAST
REINFORCED CONCRETE UNLESS
OTHERWISE APPROVED BY THE
ENGINEER.

NOTE:
BELOW 15' DEPTH MEASURED FOR
PRESENT GROUND SURFACE, MANHOLE
WALLS SHALL BE 12\"/>

5' DRAINAGE STRUCTURE

CITY OF WYOMING
ENGINEERING DEPARTMENT

**5' DRAINAGE
STRUCTURE**

DRAWN BY - KJM
CHECKED BY - JJO
DATE DRAWN - 3-2021
DATE REVISED - 3-2021

S-7B